



CIN - U40108CT2003SGC015820

CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED
छत्तीसगढ़ राज्य विद्युत पारेषण कम्पनी मर्यादित
(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपक्रम)
CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR
छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर
दूरभाष Phone : 0771-2574172
फैक्स Fax No. 0771-2574174
Website : www.sldccg.com
Email- dsm@sldccg.com

SUMMARY OF STATEMENT OF SDSMA ACCOUNT (PROVISIONAL)

No:- 03-02/SLDC /DSM /6 / 1666

Date : 05 JAN 2022

To,

The General Manager (Finance)
 CSP Distribution Co. Ltd.,
 Dangania, Raipur.

Sub :-Provisional statement of State Deviation Settlement Mechanism Account (SDSMA) for the period from 20-Dec-2021 to 26-Dec-2021 in respect of Sellers/Buyers, who have availed open access except CSPGCL and RE-generators.

Please find enclosed herewith the provisional statement of State Deviation Settlement Mechanism Account (SDSMA) in respect of Sellers/Buyers, who have availed open access and scheduled their energy (except CSPGCL and RE-generators) for the period from 20-Dec-2021 to 26-Dec-2021 for information and necessary action. The SDSMA statement has been prepared on the basis of meter-readings as provided by the respective metering agency, the Implemented Injection/Drawal Schedule under Open-Access as uploaded in SLDC/WRLDC Website and E-mail as received from Power Exchange, Frequency as considered by WRPC for CSPDCL and other inputs as per CSERC (Intra-State ABT and DSM) Regulations, 2016.

The Provisional SDSMA Statement in respect of following Seller/Buyer is being issued after due confirmation of Meter Reading and Schedule as per Reg. 11.1 (e) of CSERC (Intra-State ABT and DSM) Regulations, 2016.

Billing Ref.No :- SLDC/DSM/2021-W51

Summary of SDSMA Charges for period from 20-Dec-2021 to 26-Dec-2021

ENTITY_ID (Type)	Total Injected/Drawal Energy in KWh	Total Schedule towards open access in KWh	Contract Demand# (PF=0.9) in KWH	Total Deviation Energy in KWh	CFD** for Underinjection/ Overdrawl In ₹	CFD** for Overinjection/ Underdrawl In ₹	Addl_CFD** for Underinjection/ Overdrawl in ₹	Addl_CFD** for Overinjection/ Underdrawl in ₹	Total DSM Charges* In ₹	Deviation* In %
[1]	[2]	[3]	[4]	[5]	[6]	[7]	[8]	[9]	[10]	[11]
1. SKSIP CSEB (SELLER)	384,096.88	260,400.00	—	123,696.88	-29,934	77,668	-9,757	-7,436	30,542	47.50
TOTAL	384,097	260,400			-29,934	77,668	-9,757	-7,436	30,542	

* -ve (minus) implies Under-Injection/Over-drawl/Payable by the OA customer ;+ve(plus) Implies Over-injection/Under-drawl/receivable by OA customer.

** CFD means Charges for Deviation and Addl_CFD means Additional Charges for Deviation.

Contact Demand is only applicable in case of Buyer-MSC

Inconsistencies/errors observed if any, should be informed to this office within 5 days from the date of issue of the bill.

Remarks :- 1. The SDSMA bill is issued against the open access availed by above customers in the period of 20-12-2021 to 26-12-2021. Since M/s JSPL has also availed open access for the said period, but M/s JSPL has not scheduled their power for this period, so the SDSMA bill in respect of the firms could not be prepared.

2. The details of the above SDSMA statement shall be available shortly on the CGSLDC website (www.sldccg.com) under the link
Commercial -> DSM Charges of OAC.

Addl. Chief Engineer
SLDC, CSPTCL, Raipur

Copy to:-

1. The Executive Director (S/S:O&M), C.S.P.Transmission C.L., Raipur.
2. The Executive Director (R.A. & P.M.), C.S.P. Distribution C.L., Raipur.
3. The Superintending Engineer (SO), SLDC, Control-Room, C.S.P.Transmission C.L., Raipur.
4. The Superintending Engineer (MT), CSPDCL, Gudhiyari, Raipur.
5. The Executive Engineer (MRT Dn.-I), C.S.P.Transmission C.L., Gudhiyari, Raipur.
6. The EE (OA)/ EE (RA)/ Manager (F&A), O/o ED (LD), CSPTCL, Raipur.

-For information and necessary action please.



CIN - U40108CT2003SGC015820

CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED

छत्तीसगढ़ राज्य विद्युत पारिषद कम्पनी मर्यादित
(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपक्रम)
CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR

दूरभाष Phone : 0771-2574172

Website : www.sldccg.com

छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर

फैक्स Fax No. 0771-2574174

Email- dsm@sldccg.com

1. Mailing Address:-

STATEMENT OF SDSMA ACCOUNT (PROVISIONAL)

Billing Ref. No: SLDC/DSM/2021-W51

To,

M/s SKS Ispat & Power Ltd., (SKSIP CSEB)
6, 7/24 Krishna Kunj, Near Central Bank,
Civil Lines, Raipur, Distt: Raipur (CG)
492001 , Fax No -0771 4038821/2471339

Kind Attn:- Mr.Gupta Deepak/R.S.Saxena

2. Date of Issue of SDSMA Statement : **05 JAN 2022**Due Date of Payment : **15 JAN 2022**3. Summary on DSM Charges for **SKSIP CSEB (SELLER)**for the period **20-Dec-2021 to 26-Dec-2021**

For Date	Total Injected/Drawl Energy in KWh	Total Schedule towards Open access in KWh	Contract Demand# (PF=0.9) in KWh	Total Deviation Energy in KWh	Deviation Energy on Underinjection/ Overdrawl in KWh	CFD** for Underinjection/ Overdrawl In ₹	Deviation Energy on Overinjection/ Underdrawl upto 12% of schedule in KWh	CFD** for Overinjection/ Underdrawl In ₹	Add_CFD** for Underinjection/ Overdrawl in ₹	Add_CFD** for Overinjection/ Underdrawl in ₹	Total DSM Charges* in ₹
[1]	[2]	[3]	[4]	[5]	[6]	[7]	[8]	[9]	[10]	[11]	[12]
20-Dec-21	59,556.25	37,200.00	-	22,356.25	-741	-1,768	3,101	8,365	-109	-6,925	-437
21-Dec-21	61,718.75	37,200.00	-	24,518.75	-334	-1,372	3,837	13,486	-4	0	12,110
22-Dec-21	54,446.88	37,200.00	-	17,246.88	-2,469	-8,662	2,878	10,480	-4,370	0	-2,552
23-Dec-21	48,037.50	37,200.00	-	10,837.50	-2,956	-11,201	2,699	9,633	-5,108	0	-6,676
24-Dec-21	51,962.50	37,200.00	-	14,762.50	-228	-776	3,670	12,292	-40	-511	10,965
25-Dec-21	55,728.12	37,200.00	-	18,528.12	-428	-1,719	3,274	12,848	-47	0	11,082
26-Dec-21	52,646.88	37,200.00	-	15,446.88	-1,038	-4,436	2,844	10,564	-78	0	6,050
Total	384,096.88	260,400.00		123,696.88	-8,194	-29,934	22,303	77,668	-9,757	-7,436	30,542

* -ve (minus) implies payable by the OA Customer; + ve (plus) implies receivable by the OA customer

** CFD means Charges for Deviation and Add_CFD means Additional Charges for Deviation

Contact Demand is applicable only in case of MSC Buyer.

4. Technical Remarks:-

Meter_id	Meter Location:	Meter-end	Type of Meter	AMR Status at SLDC-end
APM80098	220 KV S/s Siltara	Substation End	MAIN	Communication fail

5. Letter of Credit Details:-

Avg. Wkly Payable DSM for Pre. Qtr (JUL21 - SEP21) (₹)	Highest Wkly Payable DSM for Curr. Qtr. (OCT21 - DEC21) (₹)	LC to be Paid (₹)
238,951	312,765	Amount of LC as due may please be confirmed from office of the GM (Finance), CSPDCL, Raipur.

6. Billing Remarks:-

- Inconsistencies/errors observed if any, should be informed to this office within 5 days from the date of issue of the bill.
- The bill amount of SDSMA Charges is receivable to you from CSPDCL, which is to be settled by the O/o GM (Finance), CSPDCL, Raipur.
- The Deviation Pool A/C no. is maintained by CSPDCL, therefore please contact with the officials of the GM (Finance), CSPDCL at 0771-2574340. Since all the matters related to commercial settlement of DSM Charges and Letter of Credit (LC) related matters shall be taken care by CSPDCL.

A/C details of CSPDCL are as under :-

- Name of Account - "CSPDCL DEVIATION POOL ACCOUNT"
- Name of Bank and Branch - Union Bank of India, Lilli Chowk Branch Raipur
- Vendor Sub-Account Number. - 619401010050442
- IFSC Code - UBIN0561941

- Please check the AMR status as per Sr no. 4 of this bill and rectify the error at the earliest, if any. Otherwise Open access permission/NOC may be denied.
- The details of above DSM charges statement is available in the CGSLDC website www.sldccg.com under the link Commercial->DSM Charges of OAC.

7. Notice :-

(1). It is observed that you have contravened the limits on Deviation volume & consequences of crossing limits as specified in Regulation 7 of CSERC (Intra-state Availability Based Tariff and Deviation Settlement Mechanism) Regulations, 2016 as under :-

(I). Number of time blocks where deviation from schedule exceeds 12% of schedule when freq is 49.7 Hz & above and below 50.10 Hz = **493**(II). Number of time blocks where under-injection/over-drawl observed when freq is below 49.7 Hz = **0**(III). Number of time blocks where over-injection/under-drawl observed when freq is 50.10 Hz & above = **8**Addl. Chief Engineer
SLDC, CSPTCL, Raipur

**Violation Report under Deviation volume and consequences of crossing limits as per Regulation 7 of CSERC
(Intra-state ABT and Deviation Settlement Mechanism Regulation 2016 in respect of Sellers/Buyers**

period from 20-Dec-21 to 26-Dec-21

(1) Over-injection/Underdrawl of electricity during a time-block when frequency is 50.10 Hz and above

	20-Dec-21	24-Dec-21	Total
	No of TimeBlock	No of TimeBlock	
SKSIP CSEB	6	2	8

(2) Deviation of electricity during a time-block exceeds 12% of schedule or 150 MW, whichever is lower when frequency is 49.7 Hz and above and below 50.10 Hz

	20-Dec-21	21-Dec-21	22-Dec-21	23-Dec-21	24-Dec-21	25-Dec-21	26-Dec-21	Total
	No of TimeBlock	No of TimeBlock	No of TimeBlock	No of TimeBlock	No of TimeBlock	No of TimeBlock	No of TimeBlock	
SKSIP CSEB	65	79	76	71	72	64	66	493

(3) Under-injection/Overdrawl of electricity during a time-block when frequency is below 49.7 Hz

_____ Nil _____



CIN - U40108CT2003SGC015820

CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED


छत्तीसगढ़ राज्य विद्युत पारेषण कम्पनी मर्यादित
(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपक्रम)
CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR
छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर

1. Deviation in respect of SKSIP CSEB for the period 20-Dec-2021 to 26-Dec-2021

Scheduled Date	Total Injected/ Drawl Energy in KWh	Schedule towards Open access in KWh	Contract Demand# (PF=0.9) in KWh	Deviation in KWh	Deviation in %
20-Dec-21	59,556	37,200	--	22,356	60.10 %
21-Dec-21	61,719	37,200	--	24,519	65.91 %
22-Dec-21	54,447	37,200	--	17,247	46.36 %
23-Dec-21	48,038	37,200	--	10,838	29.13 %
24-Dec-21	51,962	37,200	--	14,762	39.68 %
25-Dec-21	55,728	37,200	--	18,528	49.81 %
26-Dec-21	52,647	37,200	--	15,447	41.52 %
Total	384,097	260,400			

Note:- 1. (+)ve deviation implies Over-injection and (-)ve deviation implies Under-injection.
2. The customer has not scheduled any power except scheduled date.

Daily Deviation Pattern

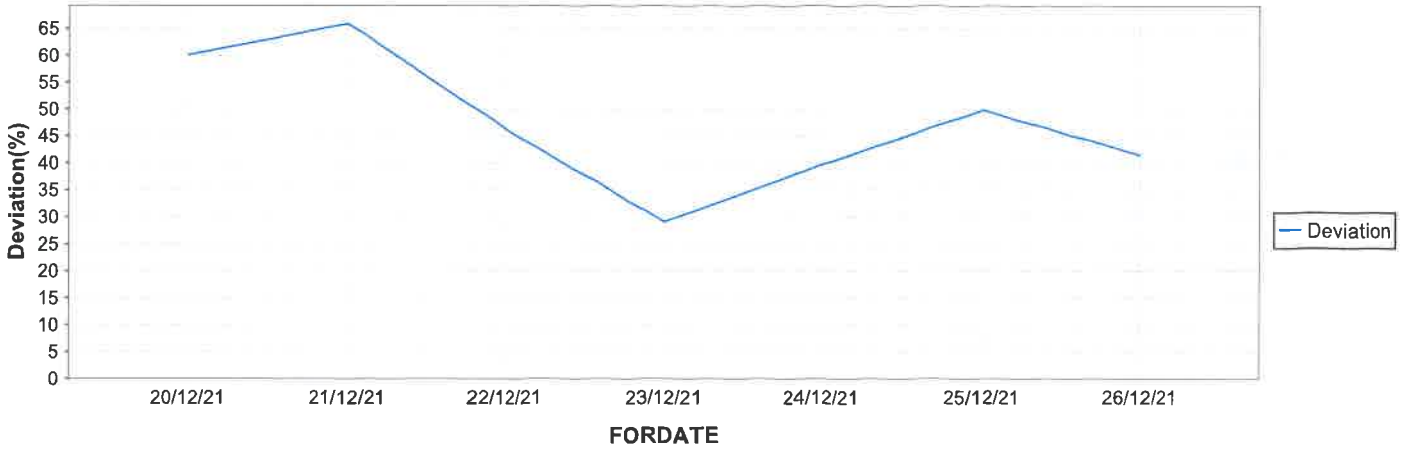

2. Limits on Deviation volume and Consequences of crossing limits as per Regulation 7 of the CSERC (Intra-state Availability Based Tariff and Deviation Settlement Mechanism) Regulations, 2016 for the period from 20-Dec-2021 to 26-Dec-2021

- (I). Number of time blocks where deviation from schedule exceeds 12% of schedule/150 MW when freq is 49.7 Hz & above and below 50.10 Hz = **493**
- (II). Number of time blocks where under-injection/over-drawl observed when freq is below 49.7 Hz = **0**
- (III). Number of time blocks where over-injection/uner-drawl observed when freq is 50.10 Hz & above = **8**

3. AMR STATUS :-

Meter_id	Meter Location:	Meter-end	Type of Meter	AMR Status at SLDC-end
APM80098	220 KV S/s Siltara	Substation End	MAIN	Communication fail