



CIN - U40108CT2003SGC015820

**CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED**  
**छत्तीसगढ़ राज्य वित्त्त पारेषण कम्पनी मर्यादित**  
**(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपकर्म)**  
**CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR**  
**छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर**

**दूरभाष Phone : 0771-2574172**  
**Website : www.sldccg.com**

**फैक्स Fax No. 0771-2574174**  
**Email- dsm@sldccg.com**

**SUMMARY OF STATEMENT OF SDSMA ACCOUNT (PROVISIONAL)**

No:- 03-02/SLDC /DSM /6 / 322Raipur, Date : 19 MAY 2023

To,

**The General Manager (Finance)**  
 CSP Distribution Co. Ltd.,  
 Dangania, Raipur.

**Sub :-**Supplementary Provisional statement of State Deviation Settlement Mechanism Account (SDSMA) for the period from **24-Apr-2023** to **30-Apr-2023** in respect of M/s Bhagwati Power & Steel Ltd. (BPSL CSEB), who has availed open access.

**Ref :-** T.O. letter no. 03-02/SLDC/DSM/6/258/Raipur, dtd. 11/05/2023.

Please find enclosed herewith the provisional statement of State Deviation Settlement Mechanism Account (SDSMA) in respect of M/s Bhagwati Power & Steel Ltd. (BPSL CSEB), who has availed open access and scheduled their energy for the period from 24-Apr-2023 to 30-Apr-2023 for information and necessary action.

The Provisional SDSMA statement for period from **24-Apr-2023** to **30-Apr-2023** has been issued by this office vide letter cited under reference in respect of 7 no. open access customers. The issuance of SDSMA bill in respect of M/s BPSL was missed due to inadvertent error. Therefore the SDSMA bill in respect of M/s BPSL has been prepared on the basis of meter-readings as provided by the respective metering agency, the Implemented Injection/Drawal Schedule under Open-Access as uploaded in SLDC/WRLDC Website and E-mail as received from Power Exchange, and other inputs as per CSERC (Intra-State ABT and DSM) Regulations, 2016. The timeblock wise frequency and Charges for deviation has been considered as per Clause 10 of the order dtd. 28/04/2023 of Hon'ble CSERC in the Suo-Motu Petition no. 98 of 2022.

The Provisional SDSMA Statement in respect of M/s BPSL is being issued after due confirmation of Meter Reading and Schedule as per Reg. 11.1 (e) of CSERC (Intra-State ABT and DSM) Regulations, 2016.

Billing Ref.No :- SLDC/DSM/2023-W17

Summary of SDSMA Charges for period from **24-Apr-2023** to **30-Apr-2023**

ENTITY_ID (Type)	Total Injected/Drawl Energy in KWh	Total Schedule towards open access in KWh	Contract Demand# (PF=0.9) in KWh	Total Deviation Energy in KWh	CFD** for Underinjection/ Overdrawl in ₹	CFD** for Overinjection/ Underdrawl in ₹	Addl_CFD** for Underinjection/ Overdrawl in ₹	Addl_CFD** for Overinjection/ Underdrawl in ₹	Total DSM Charges* in ₹	Deviation* in %
[1]	[2]	[3]	[4]	[5]	[6]	[7]	[8]	[9]	[10]	[11]
1. BPSL CSEB (SELLER)	6,854.69	620.00	--	6,234.69	0	256	0	-75	182	1,005.59
<b>TOTAL</b>	<b>6,855</b>	<b>620</b>			<b>0</b>	<b>256</b>	<b>0</b>	<b>-75</b>	<b>182</b>	

\* -ve (minus) implies Under-Injection/Over-drawl/Payable by the OA customer ;+ve(plus) Implies Over-injection/Under-drawl/receivable by OA customer.

\*\* CFD means Charges for Deviation and Addl\_CFD means Additional Charges for Deviation.

# Contract Demand is only applicable in case of Buyer-MSD

Inconsistencies/errors observed if any, should be informed to this office within 5 days from the date of issue of the bill.

**Remarks :-** 1. The SDSMA bill is issued against the open access availed by above customers in the period of 24-04-2023 to 30-04-2023. However M/s MSPPL, M/s JSPL, M/s GSPL, M/s SNIL, and M/s SIPPL obtained standing clearance for open access, but these firms have not scheduled any power, so SDSMA bill is not applicable to these firms.  
 2. The details of the above SDSMA statement shall be available shortly on the CGSLDC website (www.sldccg.com) under the link **Commercial -> DSM Charges of OAC.**  
 3. Please turn over the page for details of receiving the data by SLDC for preparation of SDSMA charges.

**SE (Market Operation)**  
**SLDC, CSPTCL, Raipur**

Copy to:-

1. The Executive Director (S/S), C.S.P.Transmission C.L., Raipur/Bilaspur.
2. The Executive Director (R.A. & P.M.), C.S.P. Distribution C.L., Raipur.
3. The Superintending Engineer (SO), SLDC, Control-Room, C.S.P.Transmission C.L., Raipur.
4. The Executive Engineer (MRT Dn.-I), C.S.P.Transmission C.L., Gudhiyari, Raipur.
5. The EE (OA) EE (RA)/ Manager (F&A), O/o ED (LD), CSPTCL, Raipur.

-For information and necessary action please.

**Details of receiving of data by SLDC for preparation of SDSMA charges for the billing period from 10-Apr-23 to 16-Apr-23**

Entity Id	Meter Id	Meter Location	Type of Meter	AMR Status at SLDC end	Due Date of receipt of Meter Data from Metering Dn	Actual date of receipt of Meter Data	Delay in receipt of Meter Data	Non availability of Main Meter	Replacement of Main Meter	Adjustment in Main Meter reading	Delay in verify by Metering Dn.	Delay in verify by OA customer
CSPL CSEB	CSE29152	132/33 KV Champa S/s	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
JSWISPL CSEB	CSE29166	132/33 KV Chaple Raigarh S	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	1 Days
JSWISPL CSEB	CSE41311	132/33 KV Chaple Raigarh S	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	1 Days
MSPPL CSEB	CSE29549	220 KV Siltara S/s	MAIN	Failed	18-Apr-23	06-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
NISL CSEB	CSE52266	33/11 KV Belha S/s	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	1 Days	No Delay
RSIPIPL CSEB	CSE29552	220/132/33 KV S/s Siltara	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
SBPIL-TLD CS	XE575949	220/132 KV Kuthrel S/s (Rait	MAIN	Failed	18-Apr-23	10-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
SIPPL CSEB	CSE52210	33/11 KV Gerwani S/s	MAIN	Failed	18-Apr-23	10-Apr-23	No Delay	NO	NO	NO	1 Days	No Delay
SKSIP CSEB	APM80098	220 KV Siltara S/s	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
VGL CSEB	CSE52042	220/132/33 KV Siltara S/s	MAIN	Failed	18-Apr-23	17-Apr-23	No Delay	NO	NO	NO	No Delay	1 Days

**Details of receiving of data by SLDC for preparation of SDSMA charges for the billing period from 17-Apr-23 to 23-Apr-23**

Entity Id	Meter Id	Meter Location	Type of Meter	AMR Status at SLDC end	Due Date of receipt of Meter Data from Metering Dn	Actual date of receipt of Meter Data	Delay in receipt of Meter Data	Non availability of Main Meter	Replacement of Main Meter	Adjustment in Main Meter reading	Delay in verify by Metering Dn.	Delay in verify by OA customer
CSPL CSEB	CSE29152	132/33 KV Champa S/s	MAIN	Failed	25-Apr-23	24-Apr-23	No Delay	NO	NO	NO	1 Days	1 Days
JSWISPL CSEB	CSE29166	132/33 KV Chaple Raigarh S	MAIN	Failed	25-Apr-23	27-Apr-23	2 Days	NO	NO	NO	No Delay	No Delay
JSWISPL CSEB	CSE41311	132/33 KV Chaple Raigarh S	MAIN	Failed	25-Apr-23	27-Apr-23	2 Days	NO	NO	NO	No Delay	No Delay
MSPPL CSEB	CSE29549	220 KV Siltara S/s	MAIN	Failed	25-Apr-23	25-Apr-23	No Delay	NO	NO	NO	1 Days	No Delay
NISL CSEB	CSE52266	33/11 KV Belha S/s	MAIN	Failed	25-Apr-23	24-Apr-23	No Delay	NO	NO	NO	No Delay	No Delay
RSIPIPL CSEB	CSE29552	220/132/33 KV S/s Siltara	MAIN	Failed	25-Apr-23	25-Apr-23	No Delay	NO	NO	NO	1 Days	No Delay
SBPIL-TLD CS	XE575949	220/132 KV Kuthrel S/s (Rait	MAIN	Failed	25-Apr-23	25-Apr-23	No Delay	NO	NO	NO	1 Days	1 Days
SKSIP CSEB	APM80098	220 KV Siltara S/s	MAIN	Failed	25-Apr-23	25-Apr-23	No Delay	NO	NO	NO	1 Days	No Delay
VGL CSEB	CSE52042	220/132/33 KV Siltara S/s	MAIN	Failed	25-Apr-23	25-Apr-23	No Delay	NO	NO	NO	1 Days	1 Days

**Details of receiving of data by SLDC for preparation of SDSMA charges for the billing period from 24-Apr-23 to 30-Apr-23**

Entity Id	Meter Id	Meter Location	Type of Meter	AMR Status at SLDC end	Due Date of receipt of Meter Data from Metering Dn	Actual date of receipt of Meter Data	Delay in receipt of Meter Data	Non availability of Main Meter	Replacement of Main Meter	Adjustment in Main Meter reading	Delay in verify by Metering Dn.	Delay in verify by OA customer
BPSL CSEB	APMB2535	220/132/33 KV Siltara S/s	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	No Delay	No Delay
CSPL CSEB	CSE29152	132/33 KV Champa S/s	MAIN	Failed	02-May-23	03-May-23	1 Days	NO	NO	NO	No Delay	No Delay
JSWISPL CSEB	CSE29166	132/33 KV Chaple Raigarh S	MAIN	Failed	02-May-23	05-May-23	3 Days	NO	NO	NO	No Delay	No Delay
JSWISPL CSEB	CSE41311	132/33 KV Chaple Raigarh S	MAIN	Failed	02-May-23	05-May-23	3 Days	NO	NO	NO	No Delay	No Delay
NISL CSEB	CSE52266	33/11 KV Belha S/s	MAIN	Failed	02-May-23	01-May-23	No Delay	NO	NO	NO	No Delay	No Delay
RSIPIPL CSEB	CSE29552	220/132/33 KV S/s Siltara	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	1 Days	No Delay
SBPIL-TLD CS	XE575949	220/132 KV Kuthrel S/s (Rait	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	1 Days	No Delay
SKSIP CSEB	APM80098	220 KV Siltara S/s	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	1 Days	No Delay
VGL CSEB	CSE52042	220/132/33 KV Siltara S/s	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	1 Days	1 Days



CIN - U40108CT2003SGC015820

**CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED**

छत्तीसगढ़ राज्य विद्युत परियोजना कम्पनी मर्यादित  
(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपक्रम)  
**CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR**

छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर  
दूरभाष Phone : 0771-2574172  
Website : www.sldccg.com

फैक्स Fax No. 0771-2574174  
Email- [dsm@sldccg.com](mailto:dsm@sldccg.com)

1. Mailing Address:-

**STATEMENT OF SDSMA ACCOUNT (PROVISIONAL)**

Billing Ref. No: SLDC/DSM/2023-W17

To,

M/s Bhagwati Power & Steel Ltd. (BPSL CSEB)  
Regd. Office D-22, Sector-5  
Devendra Nagar, Raipur(CG)  
492001 , Fax No -07721 2664411

Kind Attn:- Mr. Rajkumar Kejriwal

2. Date of Issue of SDSMA Statement : **19 MAY 2023**

Due Date of Payment : **29 MAY 2023**

3. Summary on DSM Charges for **BPSL CSEB (Seller)**

for the period **24-Apr-2023 to 30-Apr-2023**

For Date	Total Injected/Drawl Energy in KWh	Total Schedule towards Open access in KWh	Contract Demand# (PF=0.9) in KWh	Total Deviation Energy in KWh	Deviation Energy on Underinjection/ Overdrawl in KWh	CFD** for Underinjection/ Overdrawl in ₹	Deviation Energy on Overinjection/ Underdrawl upto 12% of schedule in KWh	CFD** for Overinjection/ Underdrawl in ₹	Addl_CFD** for Underinjection/ Overdrawl in ₹	Addl_CFD** for Overinjection/ Underdrawl in ₹	Total DSM Charges* in ₹
[1]	[2]	[3]	[4]	[5]	[6]	[7]	[8]	[9]	[10]	[11]	[12]
27-Apr-23	6,854.69	620.00	--	6,234.69	0	0	74	256	0	-75	182
<b>Total</b>	<b>6,854.69</b>	<b>620.00</b>		<b>6,234.69</b>	<b>0</b>	<b>0</b>	<b>74</b>	<b>256</b>	<b>0</b>	<b>-75</b>	<b>182</b>

\* -ve (minus) implies payable by the OA Customer; + ve (plus) implies receivable by the OA customer

\*\* CFD means Charges for Deviation and Addl\_CFD means Additional Charges for Deviation

# Contract Demand is applicable only in case of MSC Buyer.

4. Technical Remarks:-

Meter_id	Meter Location	Type of Meter	AMR Status at SLDC end	Due Date of receipt of Meter Data from Meterin	Actual date of receipt of Meter Data	Delay in receipt of MeterData	Non availability of Main Meter Data	Replacement of Main Meter	Adjustment in Main Meter Data	Delay in verify by Metering Dn.	Delay in verify by OACs
APMB2535	220/132/33 KV Siltara S/s	MAIN	Failed	02-May-23	04-May-23	2 Days	NO	NO	NO	No Delay	No Delay

Note:- Kindly take necessary action at your end for restoration of AMR facility.

5. Certified Grid Disturbance and its duration as published in SLDC/CSPDCL Website within a week of its occurrence- **No Data available for 24-30Apr23.**

Sl. No.	Voltage Level	Transmission Element	Line Name	From Date& Time	To Date and Time	Duration in hr:min	Remarks
--	--	--	--	--	--	--	--

6. Letter of Credit Details:-

Avg. Wkly Payable DSM for Pre. Qtr (JAN23 - MAR23) (₹)	Highest Wkly Payable DSM for Crr. Qtr. (APR23 - JUN23) (₹)	LC to be Paid (₹)
0	0	Amount of LC as due may please be confirmed from office of the GM (Finance), CSPDCL, Raipur.

7. Billing Remarks:-

- Inconsistencies/errors observed if any, should be informed to this office within 5 days from the date of issue of the bill.
- The timeblock wise frequency and rate of deviation charges has been considered as per Hon'ble CSERC order dtd. 28/04/2023 in S.M. P.N. 98/2022.
- The bill amount of SDSMA Charges is receivable to you from CSPDCL, which is to be settled by the O/o GM (Finance), CSPDCL, Raipur.
- The Deviation Pool A/C no. is maintained by CSPDCL, therefore please contact with the officials of the GM (Finance), CSPDCL at 0771-2574340. Since all the matters related to commercial settlement of DSM Charges and Letter of Credit (LC) related matters shall be taken care by CSPDCL.  
A/C details of CSPDCL are as under :-  
(i) Name of Account - "CSPDCL DEVIATION POOL ACCOUNT"  
(ii) Name of Bank and Branch - Union Bank of India, Lilli Chowk Branch Raipur  
(iii) Account Number. - 619401010050442  
(iv) IFSC Code - UBIN0561941
- Please check the AMR status as per Sr no. 4 of this bill and rectify the error at the earliest, if any. Otherwise Open access permission/NOC may be denied.
- The details of above DSM charges statement is available in the CGSLDC website [www.sldccg.com](http://www.sldccg.com) under the link Commercial->DSM Charges of OAC.

8. Notice :-

- It is observed that you have contravened the limits on Deviation volume & consequences of crossing limits as specified in Regulation 7 of CSERC (Intra-state Availability Based Tariff and Deviation Settlement Mechanism) Regulations, 2016 as under, hence you are instructed to inject/drawl power as per your schedule:-  
(I). Number of time blocks where deviation from schedule exceeds 12% of schedule when freq is 49.7 Hz & above and below 50.10 Hz = **82**  
(II). Number of time blocks where under-injection/over-drawl observed when freq is below 49.7 Hz = **0**  
(III). Number of time blocks where over-injection/uner-drawl observed when freq is 50.10 Hz & above = **2**



SE (Market Operation)  
SLDC, CSPTCL, Raipur

**Violation Report under Deviation volume and consequences of crossing limits as per Regulation 7 of CSERC  
(Intra-state ABT and Deviation Settlement Mechanism Regulation 2016 in respect of Sellers/Buyers**

Period from 24-Apr-23 to 30-Apr-23

(1) Over-injection/Underdrawl of electricity during a time-block when frequency is 50.10 Hz and above

	27-Apr-23	Total
	No of TimeBlock	
BPSL CSEB	2	2

(2) Deviation of electricity during a time-block exceeds 12% of schedule or 150 MW, whichever is lower when frequency is 49.7 Hz and above and below 50.10 Hz.

	27-Apr-23	Total
	No of TimeBlock	
BPSL CSEB	82	82

(3) Under-injection/Overdrawl of electricity during a time-block when frequency is below 49.7 Hz.

---

NIL

---



CIN - U40108CT2003SGC015820

**CHHATTISGARH STATE POWER TRANSMISSION COMPANY LIMITED**


छत्तीसगढ़ राज्य विद्युत पारेषण कम्पनी मर्यादित  
(C.G. Govt. Undertaking) (छत्तीसगढ़ शासन का एक उपक्रम)  
**CHHATTISGARH STATE LOAD DESPATCH CENTER : RAIPUR**  
छत्तीसगढ़ राज्य भार प्रेषण केन्द्र, रायपुर

**1. Deviation in respect of BPSL CSEB for the period 24-Apr-2023 to 30-Apr-2023**

Scheduled Date	Total Injected/ Drawl Energy in KWh	Schedule towards Open access in KWh	Contract Demand# (PF=0.9) in KWH	Deviation in KWh	Deviation in %
27-Apr-23	6,855	620	--	6,235	1,005.59 %
<b>Total</b>	<b>6,855</b>	<b>620</b>			

Note:- 1. (+)ve deviation implies Over-injection/Under-drawl and (-)ve deviation implies Under-injection/Over-drawl.  
2. The customer has not scheduled any power except scheduled date.

*Daily Deviation Pattern*

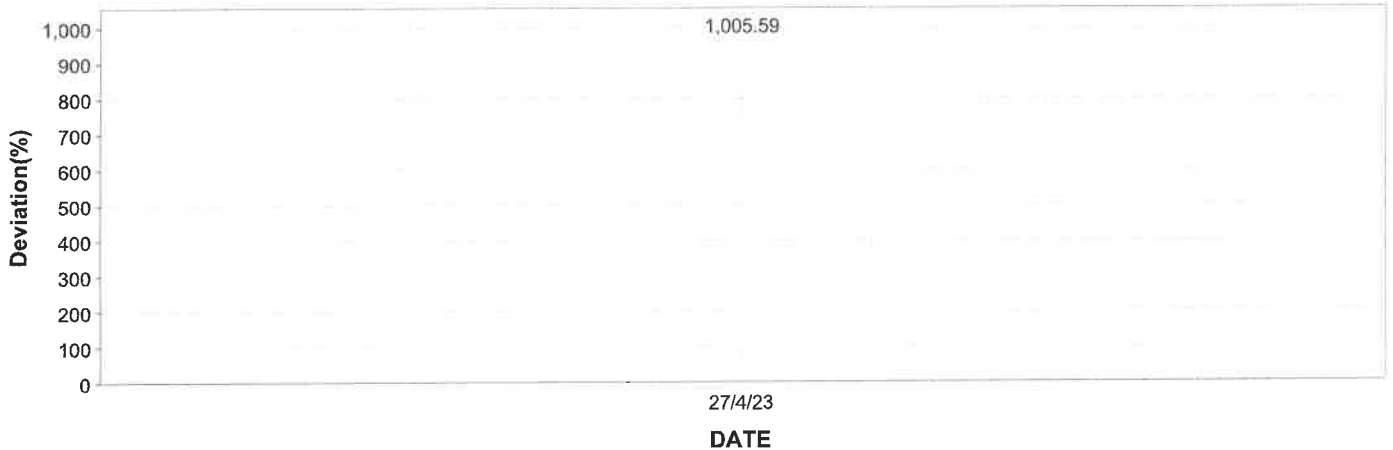

**2. It is observed that BPSL CSEB has contravened the Limits on Deviation volume and Consequences of crossing limits as per Regulation 7 of the CSERC (Intra-state Availability Based Tariff and Deviation Settlement Mechanism) Regulations, 2016 for the period from 24-Apr-2023 to 30-Apr-2023**

- (I). Number of time blocks where deviation from schedule exceeds 12% of schedule/150 MW when freq is 49.7 Hz & above and below 50.10 Hz = 82
- (II). Number of time blocks where under-injection/over-drawl observed when freq is below 49.7 Hz = 0
- (III). Number of time blocks where over-injection/uner-drawl observed when freq is 50.10 Hz & above = 2

**3. AMR STATUS :-**

Meter_id	Meter Location:	Meter-end	Type of Meter	AMR Status at SLDC-end
APMB2535	220/132/33 KV Siltara S/s	Substation End	MAIN	Failed